




Client:	Carolina Stalite Company
Project Name:	NC DOT
Project Location:	---
GTX #:	306229
Test Date:	04/19/17
Tested By:	cwd
Checked By:	emm
Boring ID:	---
Sample ID:	Bucket Sample
Depth:	---
Description:	Dry, gray lightweight aggregate

## Relative Density Test by ASTM D4253 / D4254

Relative Density - Dry Method

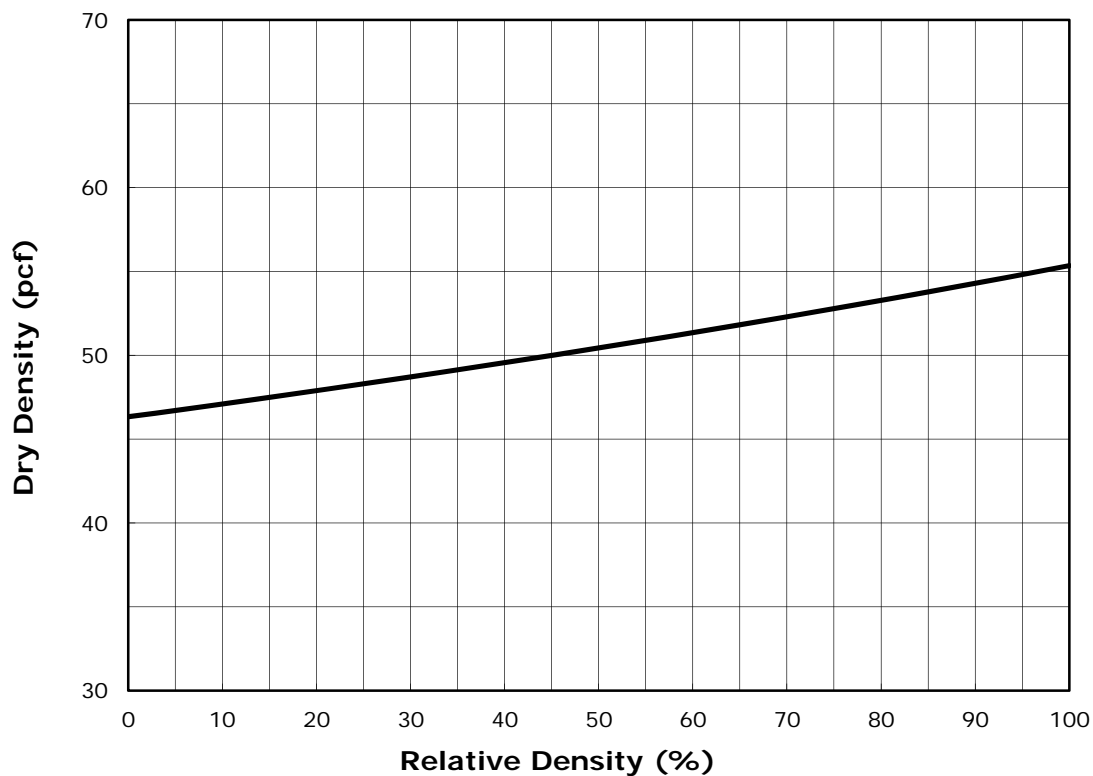

Minimum Density		46.3	pcf
Maximum Density	Dry Method	55.4	pcf
	Wet Method	---	pcf

Notes: Only Dry Method performed.